



Model 1011T **TESTANDRAIN®**


Sectional Floor Control Test and Drain Valve with Pressure Gauge for Systems Requiring Pressure Relief Valve

Sizes:

3/4"	1"	1 1/4"	1 1/2"	2"
------	----	--------	--------	----

The AGF **Model 1011T TESTANDRAIN®** provides the test and express drain functions for wet fire sprinkler systems on multi-story installations requiring pressure relief (NFPA 13 and NFPA 13R). The **Model 1011A** features a **Model 7000 Pressure Relief Valve** with drain pipe, 3 1/2" **Model 7500 Pressure Gauge** and 3-Way Globe Valve.

The **Model 1011T** is available in a full range of sizes (3/4" to 2") with NPT connections (BSPT available). The **Model 7000 Pressure Relief Valve** (UL/FM) features a flushing handle and a 175 PSI factory rating (other pressure ratings available).

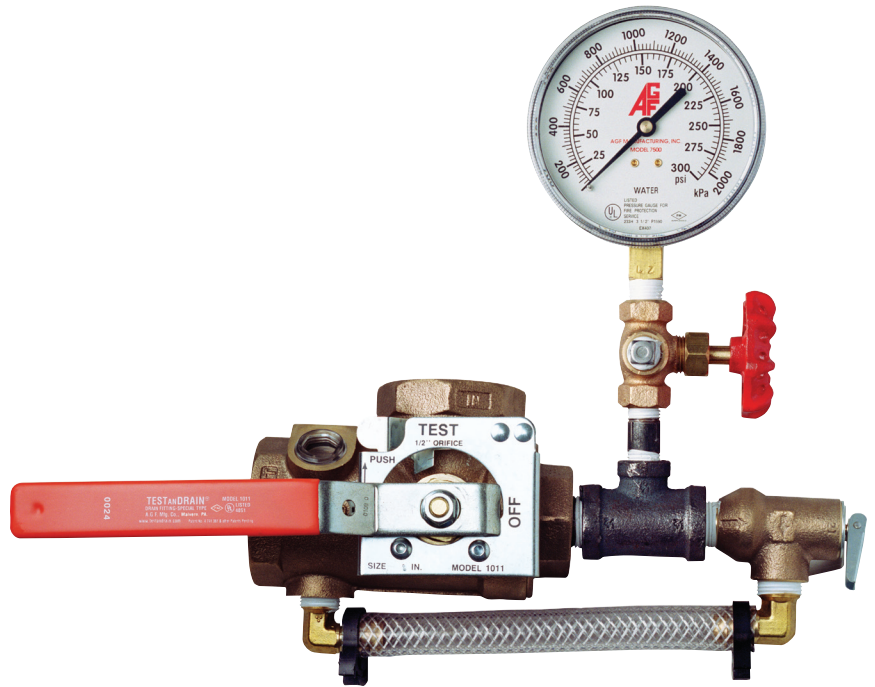

- Complies with NFPA 13 Requirements
- Compact, Single-Handle Ball Valve
- Tamper-Resistant Test Orifice and Sight Glasses
- 300 PSI rated.
- Specifiable orifice sizes: 3/8" (2.8K), 7/16" (4.2K), 1/2" (5.6K), 17/32" (8.0K), 5/8" (11.2K, ELO), 3/4" (14.0K, ESFR), and K25
- Relieves Excess System Pressure caused by Surges or Temperature Changes
- Includes **Model 7500 Pressure Gauge** and UL/FM **Model 7600 Globe Valve**
- Shipped with Relief Valve and Bypass Drain Ports Plugged to Expedite Pressure Testing
- Locking Kit Available

Repair kits are available for all **TESTANDRAIN®** valves. Kit includes: Adapter Gasket (1), Ball (1), Valve Seats (2), Stem Packing (1), and Stem Washer (1). *Valve and orifice size must be specified when ordering.*

NOTE: It is important to note that the pressure rating of the relief valve indicates an operating range of pressure for both opening and closing of the valve. Standard relief valves are required to OPEN in a range of pressure between 90% and 105% of their rating. The valves are required to CLOSE at a pressure above 80% of that rating. The relief valve should be installed where it is easily accessible for maintenance. Care should be taken that the relief valve CANNOT be isolated from the system when the system is operational. A relief valve should NEVER have a shutoff valve or a plug downstream of its outlet.

Reliability, Versatility, Code Compatibility



Model 1011T TEST AND DRAIN®

Model 1011T 300 PSI Bronze Ball Valve, Model 7000 Pressure Relief Valve, Model 7500 Pressure Gauge, and Model 7600 1/4" 3-Way Globe Valve

Dimensions


SIZE	A	B	C	D	E	F
3/4"	10 1/4" (256 mm)	3 3/8" (86 mm)	1 13/16" (46 mm)	4 9/16" (117 mm)	6 3/8" (162.5 mm)	8 3/4" (119 mm)
1"	10 1/4" (256 mm)	3 3/8" (86 mm)	1 13/16" (46 mm)	4 9/16" (117 mm)	6 3/8" (162.5 mm)	8 3/4" (119 mm)
1 1/4"	10 1/2" (263 mm)	3 5/8" (91 mm)	1 15/16" (51 mm)	5 9/16" (141 mm)	7 1/2" (192 mm)	9" (225 mm)
1 1/2"	11 1/2" (288 mm)	3 7/8" (99 mm)	2 5/8" (67 mm)	8 1/4" (207 mm)	10 7/8" (274 mm)	9 11/16" (242 mm)
2"	11 1/2" (288 mm)	3 7/8" (99 mm)	2 5/8" (67 mm)	8 1/4" (207 mm)	10 7/8" (274 mm)	9 11/16" (242 mm)

The Model 1011T provides the following...

From the 2013 Edition of NFPA 13

- Chapter 8.16.2.4.1* Provisions shall be made to properly drain all parts of the system.
- Chapter 8.16.2.4.2 Drain connections, interior sectional or floor control valve(s) – & 8.16.2.4.3 shall be provided with a drain connection having a minimum size as shown in Table 8.16.2.4.2.
- Chapter 8.16.2.4.4 Drains shall discharge outside or to a drain capable of handling the flow of the drain.
- Chapter A.8.17.4.2 (Wet Pipe System) test connection is permitted to terminate into a drain capable of accepting full flow... using an approved sight test connection containing a smooth bore corrosion-resistant orifice giving a flow equivalent to one sprinkler...
- Chapter 8.17.4.2.2 The test connection valve shall be accessible.
- Chapter 8.17.4.2.4 shall be permitted to be installed in any location... downstream of the waterflow alarm.
- Chapter 8.17.4.3.1 (Dry Pipe System) a trip test connection not less than 1" in diameter, terminating in a smooth bore corrosion-resistant orifice, to provide a flow equivalent to one sprinkler...
- Chapter 8.17.4.3.2 The trip test connection... with a shutoff valve and plug not less than 1", at least one of which shall be brass.
- Chapter 7.1.2 - a wet pipe system shall be provided with a listed relief valve set to operate at 175 PSI or 10 PSI in excess of the maximum system pressure, whichever is greater.
- Chapter 8.16.1.2.3* A listed relief valve of not less than 1/2" in size shall be provided on the discharge side of the pressure-reducing valve set to operate at a pressure not exceeding rated pressure of the system.
- Chapter A.8.16.1.2.3 - consideration should be given to piping the discharge from the (pressure relief) valve
- Chapter 8.16.1.2.2 Pressure gauges shall be installed on the inlet and outlet sides of each pressure reducing valve.

Model 1011T - Front View

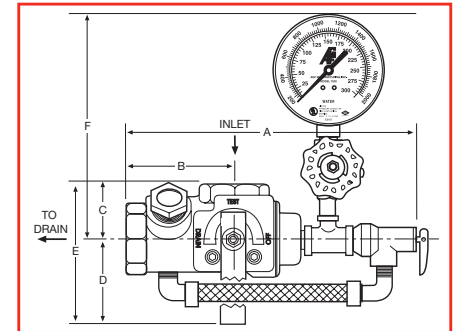

Orifice Sizes

3/8", 7/16", 1/2", 17/32", 5/8" ELO*,
3/4" ESRF*, and K25**

Materials

- Handle Steel
- Stem Rod Brass
- Ball..... C.P. Brass
- Body Bronze
- Valve Seat..... Impregnated Teflon®
- Indicator Plate Steel
- Relief Valve Bronze
- Bypass Fittings... Brass
- Bypass Tubing.... Nylobraided

Approvals

UL and ULC Listed:
(EX4019 & EX4533)
FM Approved
NYC-BSA No. 720-87-SM



USA Patent # 4741361 and Other Patents Pending



AGF Manufacturing Inc.
100 Quaker Lane, Malvern, PA 19355
Phone: 610-240-4900
Fax: 610-240-4906
www.testandrain.com

Job Name: _____
Architect: _____
Engineer: _____
Contractor: _____

*Available on 1 1/4" to 2" size units only • **Available on 1 1/2" and 2" size units only